



NC89 V6.3.2 installation- Electrical modification

All electrical work should be carried out by licenced electrician.

When installing a replacement NC89 first check what version the old controller is. This is done by turning the controller over and looking at the version number in the top right corner. If replacing any old version NC89 with a new version V6.3.2 then an extra wire needs to be installed.

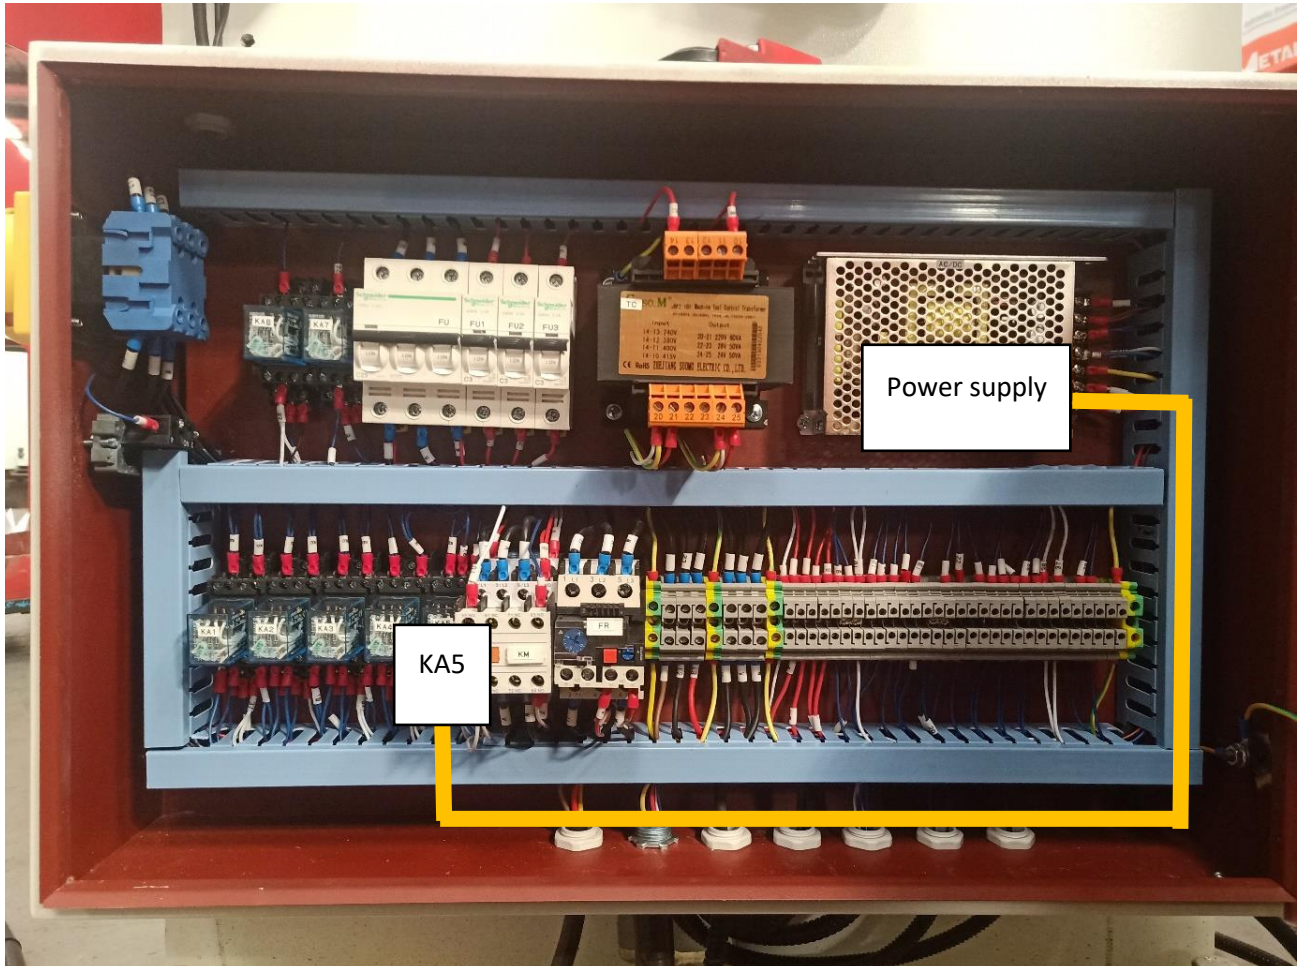

Install an extra wire between power supply wire-10 & KA5 wire- 37

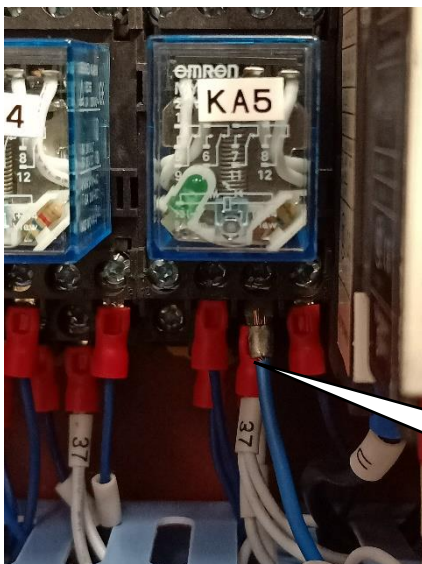

Power supply, wire- 10

KA5, wire-37

